

ERCOT Residential DR Program Analysis

PREPARED BY

Ryan Hledik
Sam Newell
Kate Peters
Serena Patel
Carly McAdam

PREPARED FOR

ERCOT Wholesale
Market Subcommittee
(WMS)

NOVEMBER 5, 2025



Notice

This presentation was prepared by The Brattle Group as a preview of a forthcoming report prepared for NRG and Google. It is intended to be read and used as a whole and not in parts. The report reflects the analyses and opinions of the authors and does not necessarily reflect those of The Brattle Group's clients or other consultants.

Any wholesale market characterizations herein are not intended to be predictive of a future grid state, rather they are baseline assumptions used to assess the price impact of demand response.


We would like to thank Bill Barnes and Travis Kavulla (NRG) and Easar Forghany and Chris Matos (Google) for helpful input and insight throughout this study.

Copyright © 2025 The Brattle Group, Inc.

Background

- Over [60 GW of load growth](#) anticipated in ERCOT by 2031, driven primarily by data centers and other large loads
- Concern that conventional sources of supply will not keep up with load growth, leading to reliability challenges
- Residential demand response (DR) remains relatively untapped in ERCOT, despite large air-conditioning load
- In other markets, cost-effective participation compensation and effective program design have led to residential DR participation rates in excess of 20%
- Nationally, there is 10 GW of residential DR in utility programs
- ERCOT's Residential DR (RDR) program is designed to provide REPs and NOIEs with a price signal to develop programs that tap into latent residential flexibility to address reliability concerns

Residential Demand Response Capability, by State

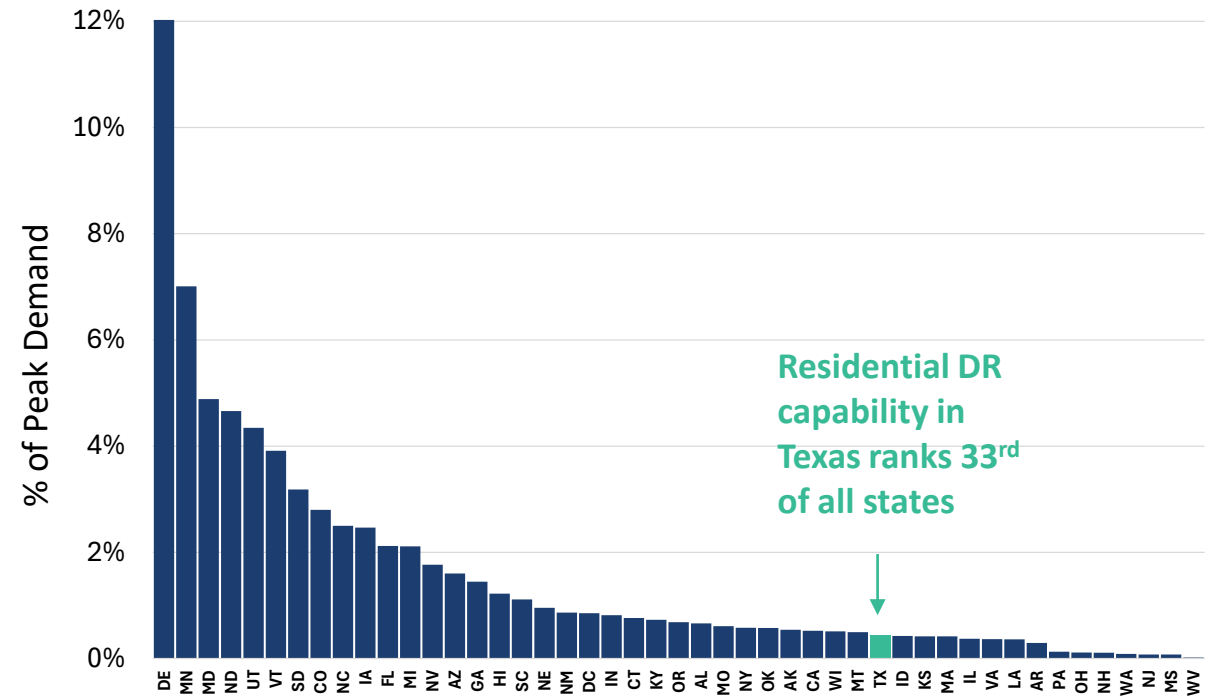

Note: Only states with non-zero DR shown (47 states). Data from [Form EIA-861](#), 2024.

Purpose and approach

Study purpose

- NRG and Google commissioned Brattle to analyze the potential impacts of ERCOT's proposed RDR program if it is adopted
- Focus on potential impacts in next 3 to 5 years

Research questions

- Is the RDR program likely to lead to an increase in residential DR capability?
- How will the RDR program impact market prices?

Study Approach

Define residential DR offerings utilizing smart thermostats, home batteries, and EV managed charging

Estimate monetizable DR value with and without RDR program compensation

Assess implications for higher participation incentive payments and greater ERCOT-wide DR capability


Analyze potential market price impacts of the Residential DR program at the 500 MW cap

Is the RDR program likely to lead to an increase in residential DR capability?




The Modeled DR Options

We model three residential technologies to illustrate DR opportunities in ERCOT.



Smart Thermostats

- **Smart thermostats** can be adjusted remotely to reduce air-conditioning load during DR event hours.
- Pre-cooling strategies, constraints on setpoint adjustments, and a cap on the number of events limits potential loss of customer comfort.
- Roughly [83%](#) of homes in Texas have central air-conditioning and could be incentivized to adopt a smart thermostat.
- Air-conditioning is a dominant driver of system peak demand in ERCOT.



Residential Electric Vehicle Charging

- **Residential electric vehicle (EV) charging** can be managed remotely to shift charging load to low-cost hours overnight.
- Our modeling does not include vehicle-to-grid capability, which could provide additional value once technically and commercially viable.
- Forecasts indicate that there could be [1 million light-duty EVs](#) on the road in Texas by 2030.



Residential Batteries

- **Residential batteries** can be discharged during high-priced or DR event hours and charged during low-priced hours, in addition to providing backup generation and bill savings to owners.
- Residential battery adoption is growing in ERCOT, and REPs are beginning to develop retail plans to pay customers for battery performance.
- Under NPPRR 1296, batteries are only compensated for self-consumption (i.e., not grid injection) dispatch.

Methodology overview

We simulate DR dispatch to estimate maximum monetizable value from a REP's perspective, accounting for realistic DR operational constraints to maintain customer comfort.

Operational constraints

- Technology-specific limits on number of DR dispatch events/year and hours/day (e.g., for cooling load control, max 15 calls per year and 4 consecutive hours per call)
- Account for load building outside of event hours

Value-maximizing dispatch

- DR value to REP includes combination of real-time energy, A/S procurement, and RDR compensation
- REPs target program dispatch during seasonal net peak hours to earn maximum accreditation (top 6 of 8 in Summer/Winter and top 3 of 5 in Spring/Fall)

Realistic accounting for foresight

- Imperfect foresight scenario: REP targets 10x the top net load hours with program dispatch, receives lower accreditation
- Near-perfect foresight scenario: REP targets 2x the top net load hours, receives higher accreditation


Actual market data

- Simulations and value estimates based on 2019-2024 market prices and currently proposed RDR compensation level

The Impact of RDR on Cost-Effective Compensation Payments

Increased revenue from RDR means participants could be offered cost-effective compensation payments that are 2x to 3x the levels currently supported by the market.

Maximum Cost-Effective DR Participation Incentive



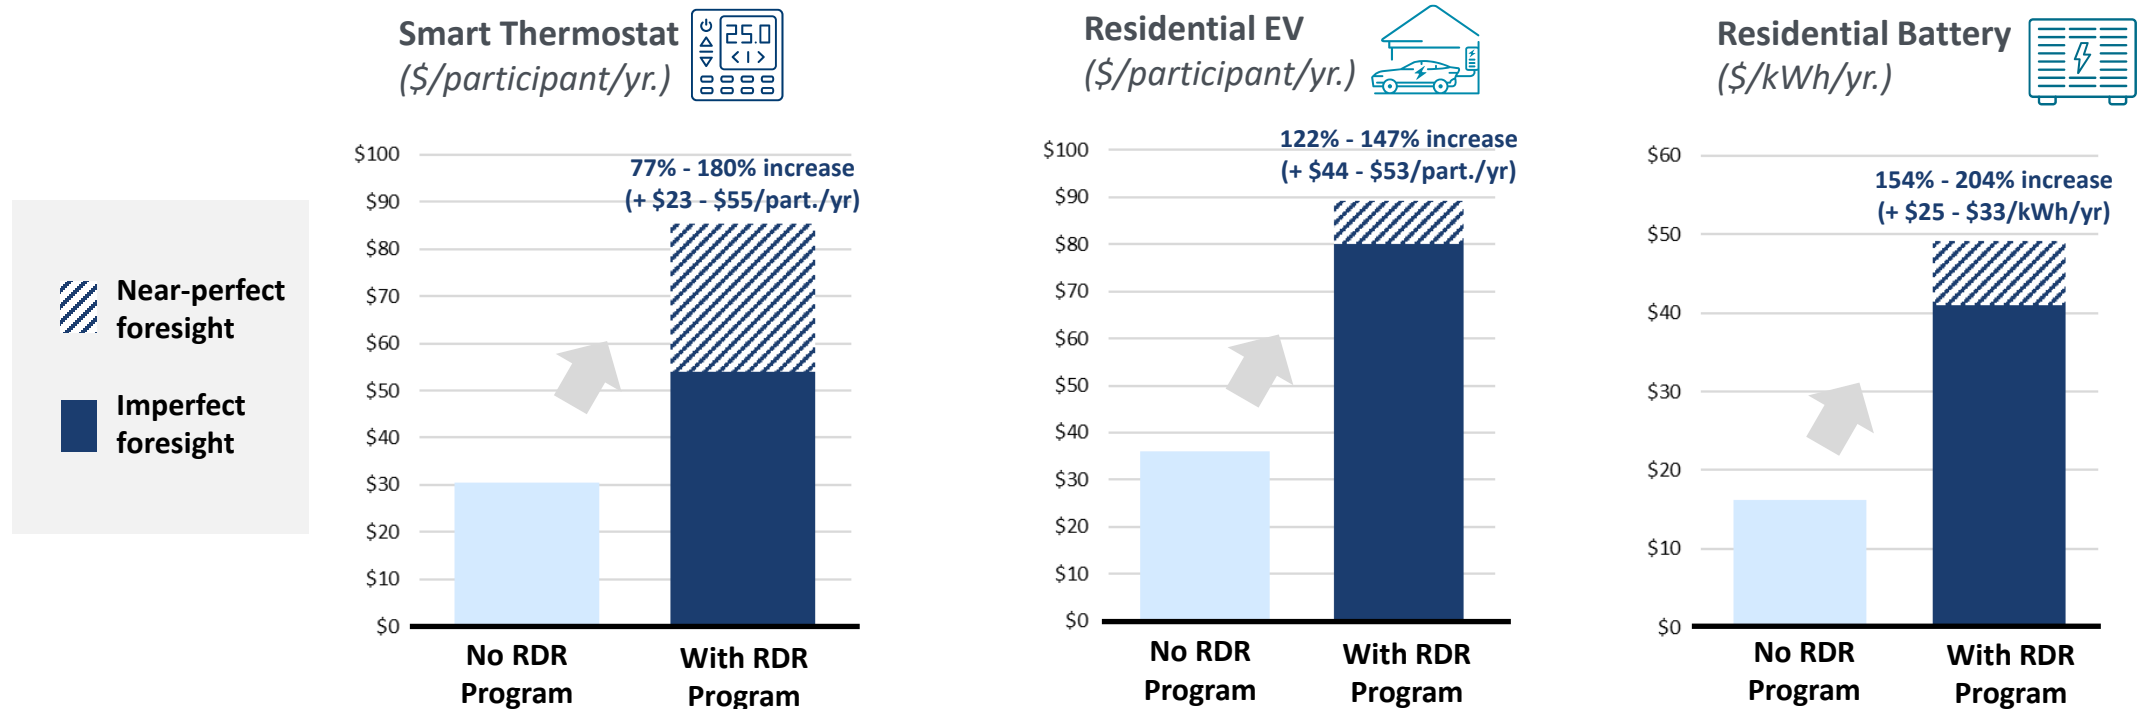


Note: Battery output is not credited for exported energy.

Benchmarking the DR Incentives to Other Jurisdictions

ERCOT's RDR program could increase cost-effective DR participation incentives offered in ERCOT's competitive retail market to levels that have supported significant enrollment in utility programs in other jurisdictions.

Benchmarking Against Participant Incentives Offered in Reviewed Utility Programs

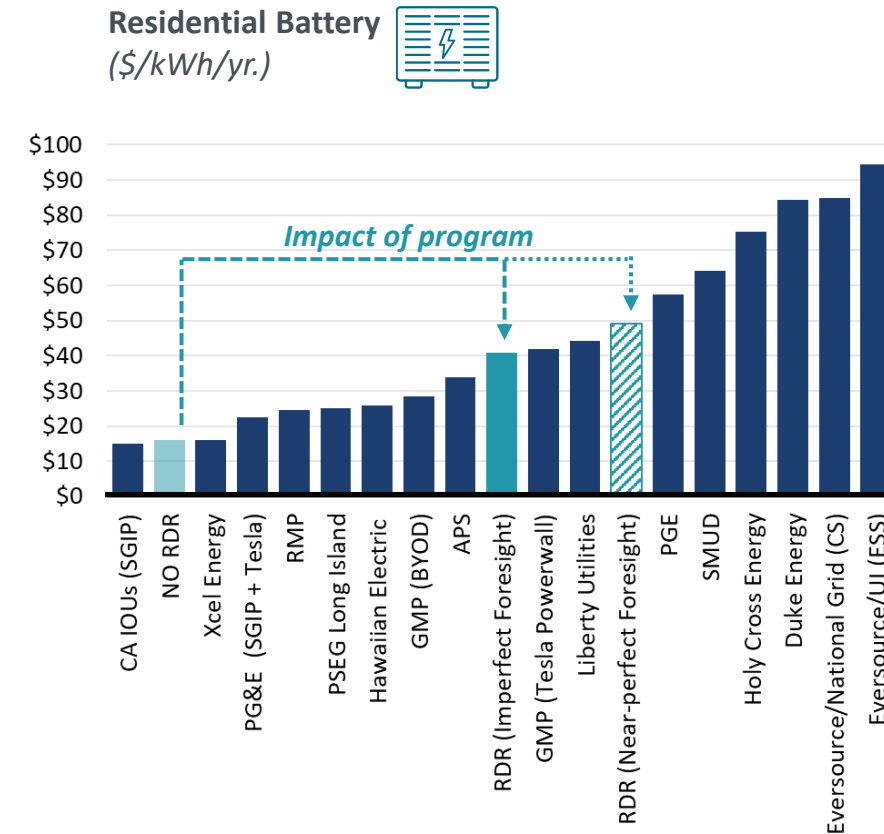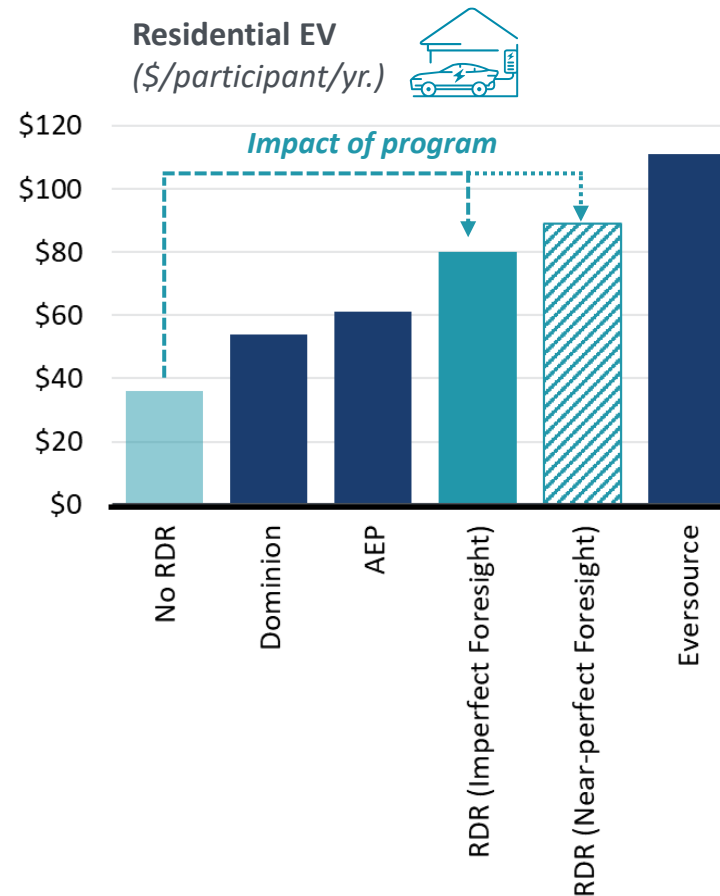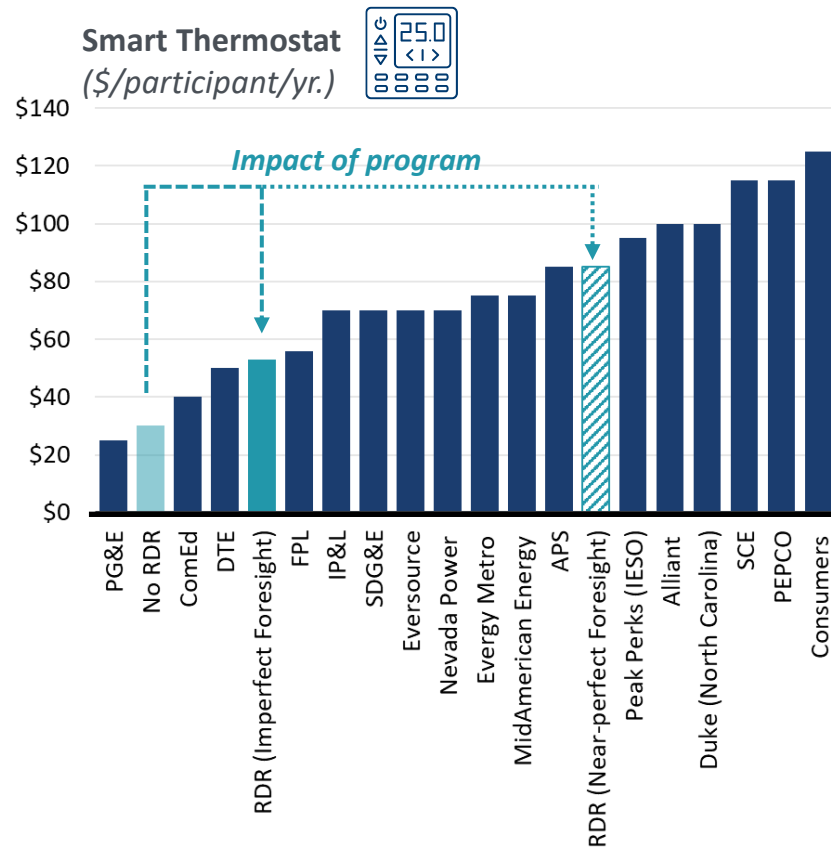

The Potential Impact of DR Program Value on DR Enrollment


By offering participation compensation at levels observed in other jurisdictions, ERCOT's DR program could reach its 500 MW enrollment cap within a few years.

Three residential DR adoption scenarios:

- **No RDR:** Future DR adoption limited to low end of what has been achieved in other jurisdictions.
- **With RDR (Moderate Adoption):** With higher, industry-standard incentives supported by implementing the proposed program, DR enrollment increases to levels achieved by successful utility offerings in other jurisdictions.
- **With RDR (High Adoption):** When coupling higher incentives with the removal of other DR deployment barriers, adoption reaches maximum levels observed in a review of various DR planning studies.

The increase in residential DR capacity associated with these scenarios could exceed the enrollment cap if eventually lifted.

2030 ERCOT Residential DR Capacity Potential

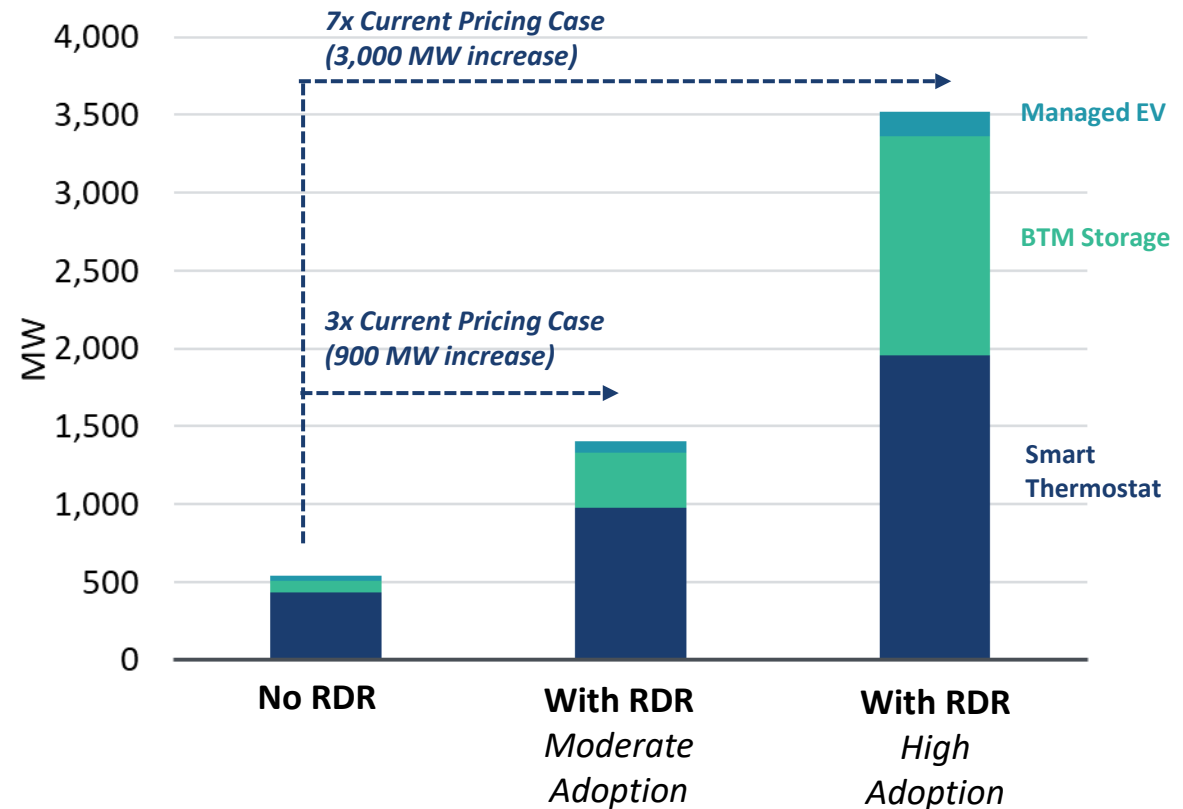

Note: Our analysis focuses on DR offerings that would be supported by direct reduction of energy and ancillary costs and contributions to residential DR accreditation hours. It does not account for alternative DR compensation opportunities in Texas, such as the ADER pilot. Further market research would be valuable to establish a direct relationship between incentives and likely DR participation.

**How will the RDR program impact
market prices?**



Methodology Overview

We develop a regression-based approach to quantify the impact of the DR program relative to forwards

Driving Question

How much will the proposed 500 MW RDR program impact the projected energy price increase relative to today's prices given forecasted additions of non-firm supply and firm demand in ERCOT?

Hypothesis

Without a price adjustment mechanism, the residential demand response program will reduce prices relative to no DR program (all else equal)


Approach

1. **Develop series of regression models** to establish a relationship between hourly reserves, gas prices, and settlement prices
2. **Forecast hourly reserves** under projected supply and demand additions, calibrated to forwards
3. **Compare the impact of the DR program** on average annual prices to ERCOT energy forwards

Building a Simplified Pricing Model

Our pricing model uses regression analysis to relate prices to hourly online and offline reserves as well as monthly gas prices, using data from 2022 and 2024

- We develop four regression models using historical hourly **reserve levels to predict prices** across different periods.
- Prices are the dependent variable, with hourly reserves as the primary independent variable and gas prices only included as a second independent variable in the off-peak model
- Implicitly, the extreme model captures effects of the ORDC; this period will be most relevant for analyzing DR dispatch

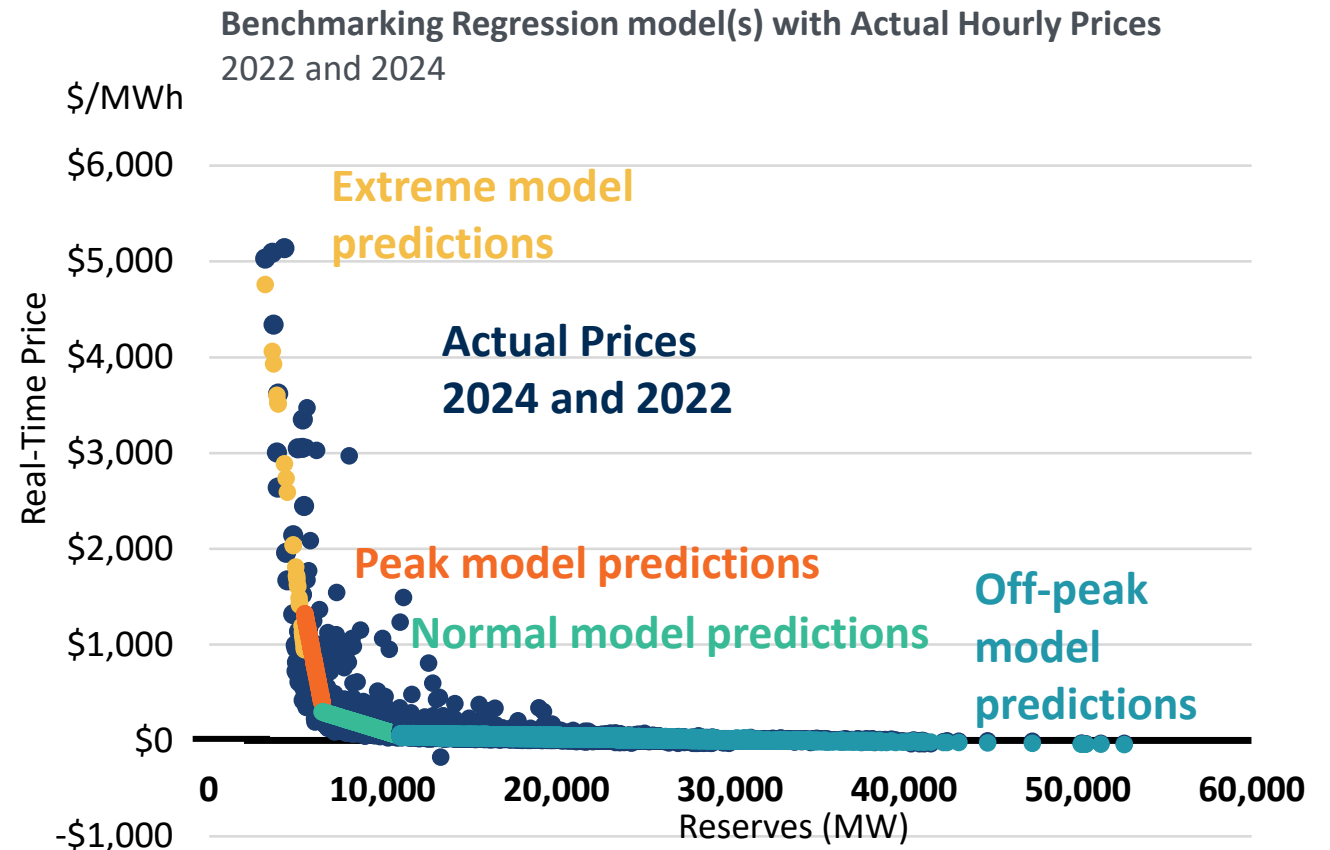


Projecting Hourly Reserves with and without DR Dispatch

We adjust historical hourly reserve levels with incremental supply and demand and calibrate to forward prices in each forecast year to project hourly operating reserves, which is the primary input to the pricing model. To test the incremental impact of DR, we represent DR dispatch as added reserves during REP-targeted top net load hours, subject to program constraints, then re-estimate prices.

- We forecast hourly operating reserves using 2022 – 2024 reserves plus weather-consistent incremental supply & demand; with load growth, the tightest hours may be tighter (rightmost part of duration curve), while many daytime hours have higher reserves due to expected additions of PV and other resources
- These reserves are applied to the pricing model (and we calibrate annual new load and resources until annual average prices match forwards)
- Finally, to estimate the DR program's price impact, we:
 - Assume a residential DR program with primarily **smart t-stat offerings**, dispatched up to 60 hours/year (May-Oct), with behavioral limits
 - Adjust the hourly operating reserves by the DR program cap (500 MW)
 - Compare the estimated prices to those without the DR.
 - This analysis is *without* modeling any RTRDPA price adjustment

Projected Reserves Duration Curve Compared to Historical

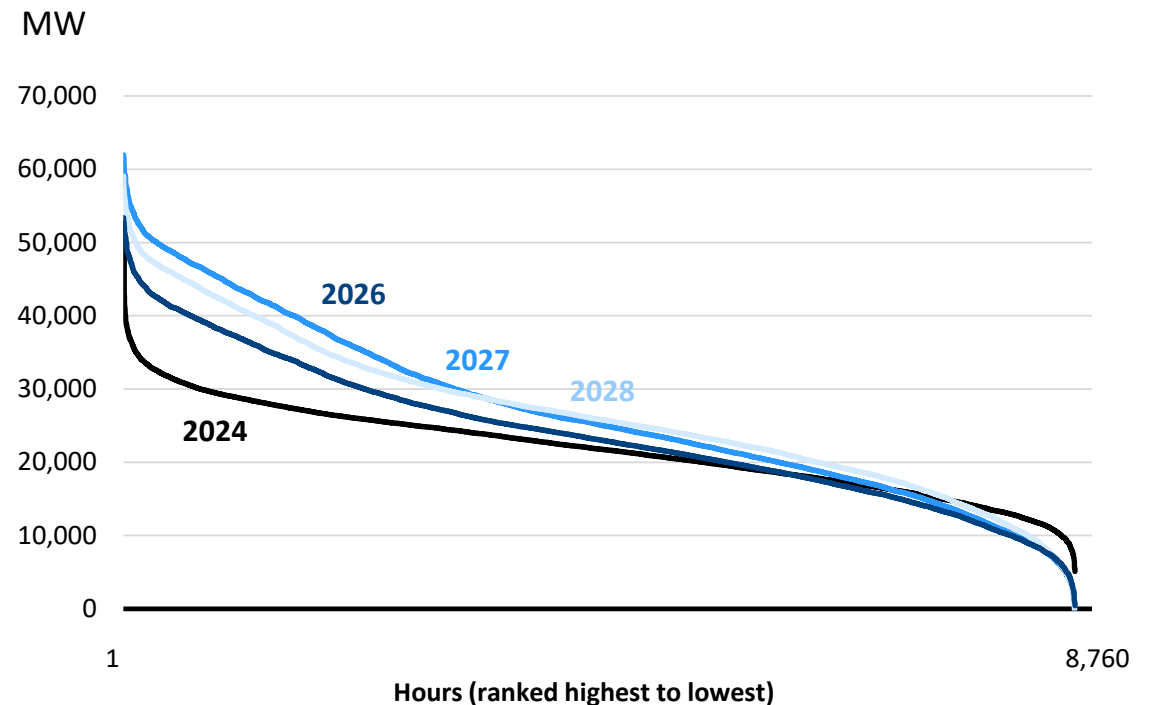


Note: These figures are not intended to be predictive of a future grid state, rather they are baseline assumptions used to assess the price impact of demand response.

DR Program has minimal effect on price

With the 500 MW participation cap, ERCOT's proposed Residential DR program will not lead to significant price suppression, relative to increasing forward prices

- ERCOT energy forwards indicate that prices will **increase +\$15-20/MWh from recent historical prices by 2028.**
- Our modeling results suggest **prices would still increase nearly as much with the DR program as proposed** (absent a price adjustment mechanism, but with a 500 MW cap).
- This is a **3-4% reduction** in average prices due to RDR, or **less than \$2/MWh on average.**

Annual Average Price With and Without DR Program
Absent Price Adjustment

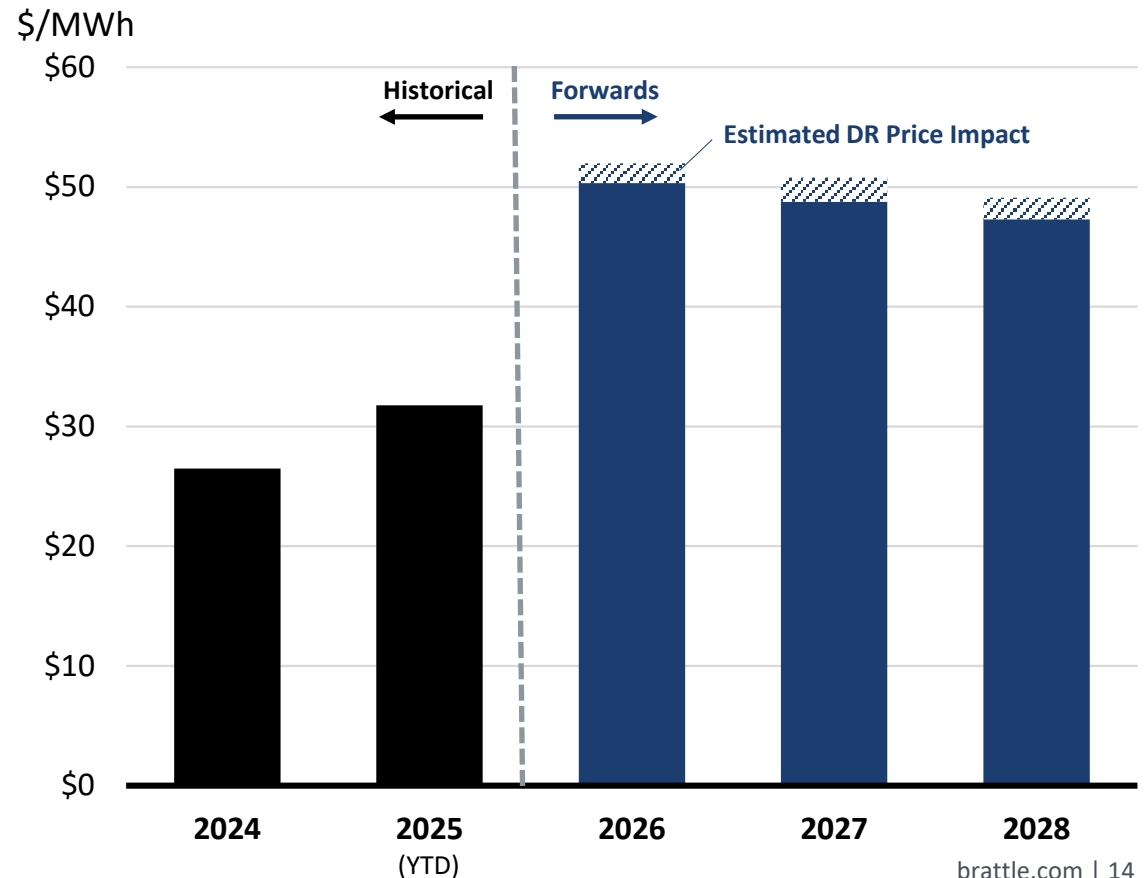

Note: These figures are not intended to be predictive of a future grid state, rather they are baseline assumptions used to assess the price impact of demand response.

Takeaways

- Customer incentives offered by REPs could **double or triple** with the introduction of the RDR program.
- Increased incentives could lead to the **500 MW RDR cap being reached within a few years** from residential smart thermostats, EVs, and batteries.
- ERCOT is anticipating significant demand growth and tightening of reserves through 2030. The RDR program allows the **mobilization of dispatchable capacity** in the market.
- RDR has the **potential to exceed the cap** if it is eventually lifted.
- In addition to relieving a strained supply-demand balance in the near term, RDR could improve residential customers' familiarity, experience, and capability with respect to DR, creating a **foundation for a more price responsive residential customer base**
- The introduction of DR as proposed could **lower prices by 3-4% relative to forwards**, which is substantially less than the price increase expected from tightening reserve margins.